


“Keep your Distance!”

Minimum safe distances from overhead lines

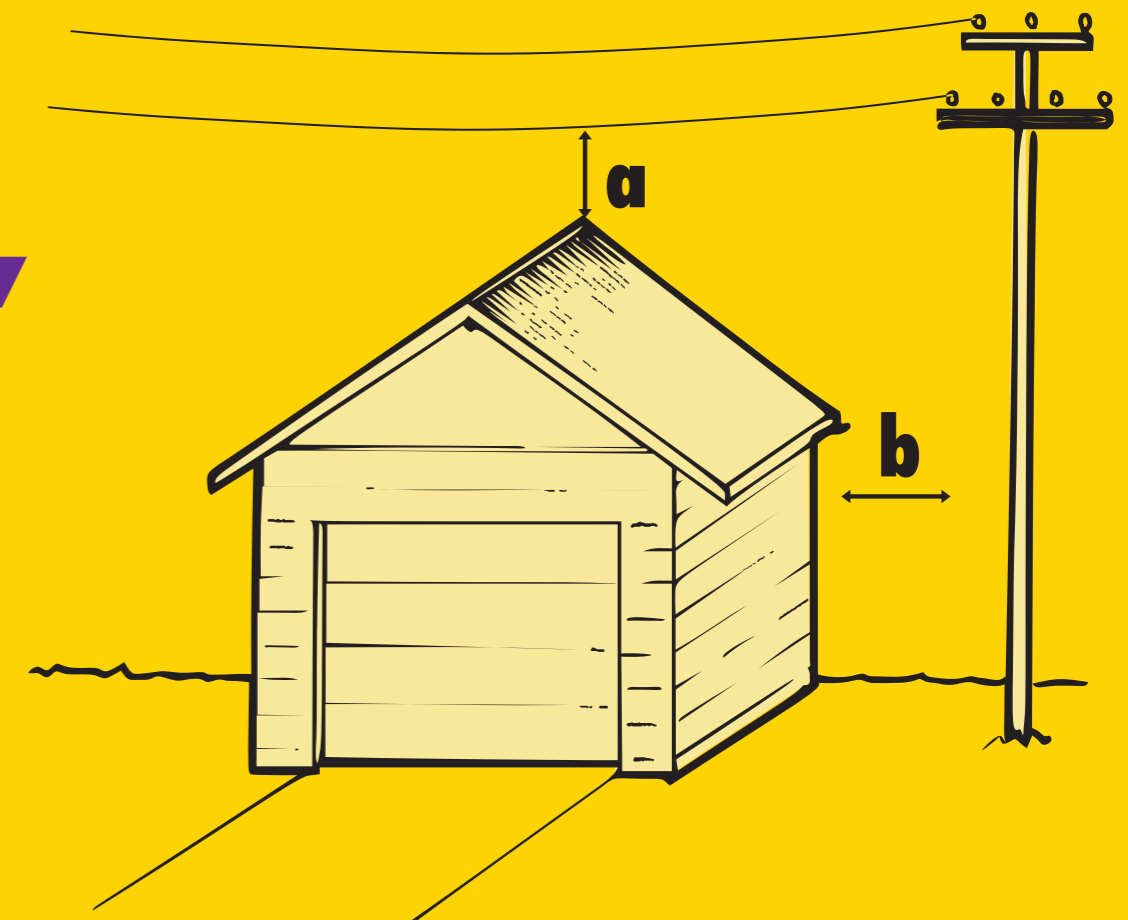

Important!

Before you start building- remember to check the minimum distances you must be from overhead lines

All people and machinery must remain 4 metres or more away from the lines at all times

Minimum safe distance from buildings to overhead lines

Voltage	“a” (distance) <i>Minimum distance beneath conductors</i>	“b” (distance) <i>Minimum distance to side of conductors</i>
Not exceeding 1kV	4m	3.5m
Exceeding 1kV but not exceeding 11kV	5.5m	5m
Exceeding 11kV but not exceeding 33kV	7m	8.5m
Exceeding 33kV but not exceeding 110kV	7.5m	9.5m
Exceeding 110kV	Refer to Table 2 Table 2 NZECP34	

0800 769 372

